



Research Article

Multi-Objective Optimal Power Flow Based Combined Non-Convex Economic Dispatch with Valve-Point Effects and Emission Using Gravitation Search Algorithm

Nabil Mezhoud* , and Mohamed Amarouyache 

Electrical Engineering Department, LES Laboratory, University of August 20th, 1955, Skikda, Algeria

* Corresponding Author: mezhounab@yahoo.fr

Abstract: This paper presents a solution to the Optimal Power Flow (OPF) problem combined economic dispatch with valve-point effect and Emission Index (EI) in electrical power networks using the physics-inspired optimization method, which is the Gravitational Search Algorithm (GSA). Our main goal is to minimize the objective function necessary for the best balance between energy production and its consumption which is presented in a nonlinear function, taking into account equality and inequality constraints. The objective is to minimize the total cost of active generations, the active power losses, and the emission index. The GSA method has been examined and tested on the standard IEEE 30-bus test system with various objective functions. The simulation results of the used methods have been compared and validated with those reported in the recent literature. The results are promising and show the effectiveness and robustness of the used method. It should be mentioned that from the base case, the cost generation, the active power losses, and the emission index are significantly reduced to 823 (\$/h), 6.038 (MW), and 0.227 (ton/h), which are considered 5.85%, 61.61%, and 44.63%, respectively.

Keywords: Optimization, optimal power flow, emission index, gravitational search algorithm.

Article history

Received 14 April 2022; Revised 09 June 2022; Accepted 29 June 2022; Published online 28 February 2023.

© 2023 Published by Shahid Chamran University of Ahvaz & Iranian Association of Electrical and Electronics Engineers (IAEEE)

How to cite this article

M. Nabil, and A. Mohamed, "Multi-objective optimal power flow based combined non-convex economic dispatch with valve-point effects and emission using gravitation search algorithm," *J. Appl. Res. Electr. Eng.*, vol. 2, no. 1, pp. 26-36, 2023. DOI: [10.22055/jaree.2022.40549.1055](https://doi.org/10.22055/jaree.2022.40549.1055)



1. INTRODUCTION

Electric power plants that operate on fossil-fuels are among the most prominent sources of air pollution and contribute to causing great harm to the environment due to the burning of raw fuels such as coal, gas, and oil [1].

Electric power systems engineering has the longest history of development compared to the various fields of engineering. In electrical supply systems, there are a wide range of problems involved in system optimization [2]. Among these problems, power system scheduling is one of the most important in system operation, control, and management.

Power plants Coal-fired contribute a large quantity of polluting gases to the Atmosphere, as they produce large amounts of Carbon oxides CO₂, and some toxic and dangerous gases such as emissions of Sulfur oxides SO_x, and Nitrogen oxides, NO_x [1-2].

After implementation of the 1990 amendment to the United States Clean Air Act and increasing public awareness of environmental protection and public utilities, electricity production companies were obligated to adapt their designs and making strategy to reduced pollution rate and emissions of electric power plants [2-3]. Several efforts and strategies have been proposed and devoted to reduce atmospheric of pollutant emissions [2].

The OPF problem has a long history in its development for more than 60 years. Since the OPF problem was first discussed by Carpenter in 1962, then formulated by Dommel and Tinney in 1968 [4]. The OPF are non-linear and non-convex very constrained optimization problems.

The ED problem is one of the concerns of statistical optimization in the planning, control and operation of electric power; he is a sub-problem of OPF [5].

The OPF is an important criterion in today's power system operation and control due to scarcity of energy

resources, increasing power generation cost and ever-growing demand for electric energy [2].

The main purpose of an OPF is to determine the optimal operating state of a power system and the corresponding settings for economic operation of control variables by optimizing a particular objective while meeting the constraints of economics and security, such as equality and inequality constraints [1, 5-6].

In the past, various optimization methods have been applied, and some of them have been implemented into practice. Over the past few years, many methods have been used to solve the OPF and EI problems like; Quadratic programming method (QP) [7], Newton and Qassi-Newton methods [8-9], linear and non-linear programming methods [10-11] and interior point methods (IPM) [12].

In the last two decades, and in order to solve the OPF and EI problems, several methods of optimization are formulated such as Artificial neural networks (ANN) [13], Artificial bee colony (ABC) and Incremental artificial bee colony (IABC) [14-15], Bacterial foraging algorithms (BFA) [16], Cuckoo search algorithm (CSA) [17], Harmony search (HS) [18], Evolution programming (EP) [19], Differential evaluation (DE) [20], Modified differential evaluation (MDE) [21], Tabu search (TS) [22], Simulated annealing (SA) [23], Gravitational search algorithms (GSA) [24], Evolutionary algorithm [25], Genetic algorithms (GA) [26], Particle swarm optimization (PSO) [27], Modified Particle swarm optimization (MPSO) [28], Ant colony optimization (ACO) [29], Tree-seed algorithm (TSA) [30], Moth Swarm Algorithm (MSA) [31], Sine-cosine algorithm (SCA) [32], Firefly Algorithm [33], Modified imperialist competitive algorithm (MICA) [34], Shuffled frog leaping algorithm (SFLA) [35], Electromagnetism-like mechanism method (ELM) [36], Ant-lion optimizer [37], Interior search algorithm [38], Wind driven optimization (WDO) method [39], Machine learning and modified grasshopper optimization algorithms [40], Rao algorithm [41], Artificial Eco-system optimization [42], Hamiltonian technique [43], Teaching-learning-studying-based optimization [44] and Grey wolf optimizer (GWO) [3, 45]. Variants of these algorithms were proposed to handle multi-objective functions in electric power systems.

The proposed GSA approach is tested and illustrated by numerical examples based on IEEE 30-bus test system.

With comparison, the obtained results validate the advantage of the proposed approach over many other methods in terms of solution quality.

2. PROBLEM FORMULATION

The OPF and EI are nonlinear optimization problems, represented by a predefined objective function f , subject to a set of equality and inequality constraints [46]. Generally, these problems can be expressed as follows.

$$\text{Min } f(x, u) \quad (1)$$

Subject to

$$h(x, u) = 0 \quad (2)$$

$$g(x, u) \leq 0 \quad (3)$$

$$x_{\min} \leq x \leq x_{\max} \quad \& \quad u_{\min} \leq u \leq u_{\max} \quad (4)$$

where $f(x, u)$ is a scalar objective function to be optimised, $h(x, u)$ and $g(x, u)$ are, respectively, the set of nonlinear equality constraints represented by the load flow equations and inequality constraints consists of state variable limits and functional operating constraints. x and u are the state and control variables vectors respectively. Hence, x and u can be expressed as given

$$x' = \{P_{G_1}, |V_{L_1}|, \dots, |V_{L_{n_L}}|, Q_{G_1}, \dots, Q_{G_{n_g}}, S_1, \dots, S_{n_{br}}\} \quad (5)$$

where, P_G , Q_G , V_L and S_k are the generating active power at slack bus, reactive power generated by all generators, magnitude voltage of all load buses and apparent power flow in all branches, respectively. n_g , n_L and n_{br} are, respectively, the total number of generators, the total number of load buses and the total number of branches.

The set control parameters are represented in terms of the decision vector as follows:

$$u' = \{P_{G_2}, \dots, P_{G_{n_g}}, |V_{G_1}|, \dots, |V_{G_{n_g}}|, Q_{1_{com}}, \dots, Q_{n_{com}}, T_1, \dots, T_{n_r}\} \quad (6)$$

where, P_G are the active power generation excluding the slack generator, V_G are the generators magnitude voltage, T is tap settings transformers, and Q_{com} are the reactive power compensation by shunt compensator, n_r and n_{com} are the total number of transformers and the total number of compensators units, respectively.

2.1. Single-Objective Function

In general, the single-objective function is a nonlinear programming problem. In this paper, four single objectives commonly found in OPF and EI have been considered.

2.1.1. Cost without valve-point optimization

The objective function of cost optimization f_1 of quadratic cost equation for all generators as given below

$$f_1 = \min \sum_{k=1}^{n_g} C(P_{gk}) = \min \sum_{k=1}^{n_g} a_k + b_k P_{gk} + c_k P_{gk}^2 \quad (7)$$

where f_1 is the total generation cost in (\$/h). P_{gk} and n_g are the active power output generated by the i^{th} generator and the total number of generators. a_k , b_k and c_k are the cost coefficients of the generator k .

2.1.2. Cost with valve-point optimization

When the valve point loading is taken into account, this model can be used as is, except for the shape of the objective function instead of being a quadratic function it is now a non-convex and smooth function as shown in Fig. 1 [14-15].

Generally, when every steam valves begins to open, the valve-point shows rippling. However, the characteristics of input-output of generation units make nonlinear and non-smooth of the fuel costs function. To consider the valve-point

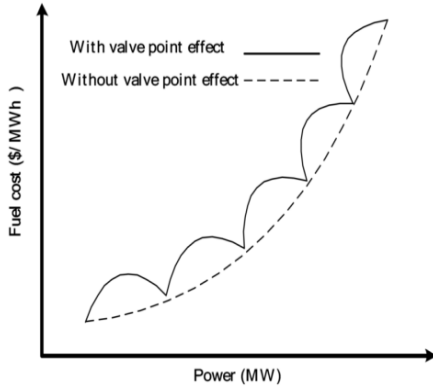


Fig. 1: Fuel cost curve of units with valve-point effects.

effect, the sinusoidal function is incorporated into the quadratic function. Typically, this function is represented as follows [14-15, 26].

$$f_2 = \min \sum_{k=1}^{n_g} [a_k + b_k P_{gk} + c_k P_{gk}^2] + |d_k \sin(e_k (P_{gk}^{\min} - P_{gk}))| \quad (8)$$

where d_k and e_k are the cost coefficients of unit with valve-point effect.

2.1.3. Active power loss optimization

The active power loss function f_3 in (MW) to be minimized can be expressed as follows

$$f_3 = \sum_{k=1}^{n_b} G_{kj} [V_k^2 + V_j^2 - 2V_k V_j \cos \theta_{kj}] \quad (9)$$

where, V_k and V_j are the magnitude voltage at buses k and j , respectively, G_{kj} is the conductance of line kj , θ_{kj} is the voltage angle between buses k and j , and n_b is total number of buses.

2.1.4. Emission optimization

The emission function is the sum of exponential and quadratic functions of real power generating. Using a quadratic equation, emission of harmful gases is calculated in (ton/h) as given below [34, 46-47].

$$f_4 = \min \sum_{k=1}^{n_g} 10^{-2} (\alpha_k + \beta_k P_{gk} + \gamma_k P_{gk}^2) + \zeta_k \exp(\lambda_k P_{gk}) \quad (10)$$

where f_4 is the emission function in (ton/h), $\alpha_k, \beta_k, \gamma_k, \zeta_k$ and λ_k are the emission coefficients of the generator k .

2.2. Multi-Objective Optimization

In all multi-objective functions, we use the weighted aggregation function. The function used in the case of weighted aggregation is given by (11).

$$MinF = \sum_{i=1}^{n_f} \omega_i f_i \text{ with } \omega_i \geq 0 \text{ and } \sum_{i=1}^{n_f} \omega_i = 1 \quad (11)$$

where $\sum_{i=1}^{n_f} \omega_i = 1$ & $i = 1:n_f$, ω_i is the weighting factor and n_f is the number of objective function considered.

2.3. Equality Constraints

These equality constraints are the sets of nonlinear load flow equations that govern the power system, i.e.:

$$\begin{cases} P_{gk} = P_k + P_{dk} \\ Q_{gk} - Q_{Comk} = Q_k + Q_{dk} \end{cases} \quad (12)$$

where P_{gk} and Q_{gk} are, respectively, the scheduled active and reactive power generations at bus k . P_k, Q_k are the active and reactive power injections at bus k . P_{dk}, Q_{dk} and Q_{comk} are the active and reactive power loads at bus k and the reactive power compensation at bus k .

2.4. Inequality Constraints

The inequality constraints $g(x,u)$ are represented by the system operational and security limits, listed below

$$P_{gk}^{\min} \leq P_{gk} \leq P_{gk}^{\max} \text{ where } k = 1, \dots, n_g \quad (13)$$

$$Q_{gk}^{\min} \leq Q_{gk} \leq Q_{gk}^{\max} \text{ where } k = 1, \dots, n_g \quad (14)$$

$$V_k^{\min} \leq V_k \leq V_k^{\max} \text{ where } k = 1, \dots, n_b \quad (15)$$

$$\theta_k^{\min} \leq \theta_k \leq \theta_k^{\max} \text{ where } k = 1, \dots, n_b \quad (16)$$

$$T_k^{\min} \leq T_k \leq T_k^{\max} \text{ where } k = 1, \dots, n_T \quad (17)$$

$$Q_{Comk}^{\min} \leq Q_{Comk} \leq Q_{Comk}^{\max} \text{ where } k = 1, \dots, n_{Com} \quad (18)$$

$$S_{kj} \leq S_{kj}^{\max} \text{ where } k = j = 1, \dots, n_b \quad (19)$$

where, n_T, n_{Com}, T and Q_{Com} are the total number of transformers, total number of compensators, transformers tap settings, the reactive power compensation and S_{kj}^{\max} is the maximum apparent power between buses k and j .

2.5. Gravitation Search Algorithm

Gravity Search Algorithm (GSA) is one of the recent algorithms developed by Rashidi et al. [48]. GSA is also a meta-heuristic method inspired by Newtonian laws of gravitation and mass interactions [24, 47-48]. The agents in the GSA method are the targets whose performance is measured by their masses. Each agent attracts another agent by a force of gravity which is inversely proportional to the square of the distance between the agents and directly proportional to the product of their mass. By means of the Newtonian law of motion this force creates a global movement of all agents towards the heavier masses.

Compared to lighter agents, heavier agents move very slowly which correspond to good solutions to the problem [24,49].

In the GSA method [48-50], the agents/vectors of the solution are considered as objects and their performance is measured by their masses. Each mass (agent) has specified by four specifications: position of the mass, inertial mass, active gravitational mass and passive gravitational mass. The position of the mass corresponds to the solution of the

problem, and its gravitational and inertial masses are computed using a fitness function. The algorithm is navigated by properly adjusting the gravitational and inertial masses. By lapse of iteration cycles, it is expected that masses be attracted by the heaviest mass. This heaviest mass will present an optimum solution in the search space [24].

The GSA could be considered as an isolated masses system. It is like a small artificial world of masses obeying the Newtonian laws of gravitation and motion. More precisely, masses obey the following two laws [50].

Now, let us consider a system with N_a agents (masses). The position of the i^{th} agent is defined by

$$x_i = (x_i^1, \dots, x_i^d, \dots, x_i^D) \quad \text{where } i = 1, \dots, N_a \quad (20)$$

where x_i^d represents the positions of the i_{th} agent in the d_{th} dimension, which is a candidate solution to the problem, D is the space dimension of the problem and N_a is total number of agents in the swarm [48].

Initially, the agents of the solution are defined according to Newton gravitation theory. At a specific iteration t , the force acting on i^{th} mass from j^{th} mass according to Newton gravitation theory is defined randomly as follows

$$F_{ij}^d(t) = G(t) \frac{M_{pi}(t) \times M_{aj}(t)}{R_{ij}(t) + \varepsilon} (x_j^d(t) - x_i^d(t)) \quad (21)$$

where M_{pi} is the mass of the object i , M_{aj} the mass of the object j , $G(t)$ is the gravitational constant at time t , ε is a small constant and $R_{ij}(t)$ is the Euclidean distance between two agents i and j given as follows.

$$R_{ij}(t) = \|x_i(t), x_j(t)\|_2 \quad (22)$$

To give a stochastic characteristic to the algorithm, it is expected that the total force that acts on i_{th} agent in d^{th} dimension be a randomly weighted sum of d^{th} components of the forces exerted from other agents given by the following equation

$$F_i^d(t) = \sum_{\substack{j=1 \\ j \neq i}}^{N_a} rand_j F_{ij}^d(t) \quad (23)$$

where $rand_j$ is uniform random variable in the interval $[0, 1]$, this random is used to give a randomized characteristic to the search [48, 50].

The law of motion is used directly to calculate the acceleration of i^{th} agent, at time t in the d^{th} dimension. This acceleration is proportional to the force acting on that agent, and inversely proportional to the mass agent. a_i^d is given as

$$a_i^d(t) = \frac{F_i^d(t)}{M_{ii}(t)} \quad (24)$$

where $M_{ii}(t)$ is the inertial mass of the i^{th} agent and $a_i^d(t)$ is the acceleration of i^{th} agent in the d_{th} dimension at iteration t .

Moreover, a search strategy can be defined on this idea to find the next velocity and position of the agent. Further, the next velocity of any agent is considered a fraction of its current velocity and current acceleration. Therefore, the next velocity and the next position of an agent can be calculated as [50-51].

$$v_i^d(t+1) = rand_i \times v_i^d(t) + a_i^d(t) \quad (25)$$

$$x_i^d(t+1) = x_i^d(t) + v_i^d(t+1) \quad (26)$$

v_i^d and x_i^d are, respectively, the velocity and the position of an agent. The gravitational constant, G , which is initialized randomly at the starting, and given in terms of the initial gravitational constant (G_0) and iteration (t) expressed by (27).

$$G = G_0 \exp\left(-\alpha \frac{t}{t_{max}}\right) \quad (27)$$

where α is a user specified constant, t and t_{max} are the current and the total numbers of iterations, respectively. G_0 is set to 100, α is set to 20 [48].

The masses of agents are computed using fitness evaluation. The heavier mass of an agent, the more influential is that agent concerning the solution it represents. The masses are updated as follows:

$$M_{ai} = M_{pi} = M_{ii} \quad \text{for } i = 1, 2, \dots, N_a \quad (28)$$

$$m_i(t) = \frac{fit_i(t) - worst(t)}{best(t) - worst(t)} \quad (29)$$

where $fit_i(t)$ represents the fitness of the j_{th} agent at iteration t , $best(t)$ and $worst(t)$ represents the best and worst fitness value of all agents at generation t .

$$M_i(t) = \frac{m_i(t)}{\sum_1^{N_a} m_i(t)} \quad (30)$$

where $M_i(t)$ is the agent mass of i at iteration t . For a minimization problem

$$best(t) = \min_{j \in \{1, \dots, N_a\}} fit_j(t) \quad (31)$$

$$worst(t) = \max_{j \in \{1, \dots, N_a\}} fit_j(t) \quad (32)$$

The total force acting on the i^{th} agent is computed as follows:

$$F_i^d(t) = \sum_{\substack{j \in K_{best} \\ j \neq i}}^{N_a} rand_j F_{ij}^d(t) \quad (33)$$

K_{best} is the set of first K agents with the best fitness value and the biggest mass, which is a function of time with the initial value, K_0 and it decreases with time. In such a way, all agents apply the forces at the beginning, and as time passes, K_{best} is linearly decreased to 1. At the end, there will be only one agent applying force to the others.

2.5.1. Implementation GSA in OPF problem

At the beginning of the GSA algorithm, in the search space each agent is placed at a certain point, which defines a solution to the problem. Then, the customers are retrieved and their next locations are calculated according to (18) and (19). Other parameters of the algorithm such as masses M , gravitational constant G , and acceleration a are calculated using equations (27)-(30), and (24), respectively, and updated each iteration. The Flowchart of GSA used in this works is shown in Fig. 2.

Below we will present the steps of the GSA method to solve the problem of OPF.

Step 1: Initialization the population size of agent vectors, $N_a = 25, t_{max} = 250, G_0 = 100, \alpha = 10$

Step 2: Generation of the initial vectors of the agents N_a having that $(n + 1)$

Step 3: Calculate the values of fitness error of total population, N_a , as shown by Equation (31).

Step 4: Calculation of population best solution (hgbest).

Step 5: Update $G(t), best(t), worst(t)$ and $M_i(t)$ for $i = 1, \dots, N_a$.

Step 6: Calculate the sum of forces in different directions.

Step 7: Calculate the factor velocities and accelerations.

Step 8: Update the position of agent's.

Step 9: Repeat steps 3 through 8 until the stopping criterion is met (either the maximum number of iterations or near global optimal solution, $hgbest$) is met.

3. SIMULATION & RESULTS

The five generators system, IEEE 30-bus system is used throughout this work to test the proposed algorithm. This system consist, 30 buses, 6 generators units and 41 branches, 37 of them are the transmissions lines and 4 are the tap changing transformers. One of these buses is chosen like as a reference bus (slack bus), the buses containing generators are taken the PV buses, the remaining buses are the PQ buses or loads buses. It is assumed that 9 capacitors compensation is available at buses 10, 12, 15, 17, 20, 21, 23, 24 and 29. The network data, the cost and emission coefficients of the five generators are referred in [52]. The one-line diagram IEEE 30-bus system is shown in Fig. 3.

The total loads of active and reactive powers are 283.4 (MW) and 126.2 (MVar), respectively, with 24 control variables. The basis apparent power used in this paper is 100 (MVA). The simulation results of load flow problem of test system are summarized in Table 1.

3.1.1. Case 1: Cost without valve point effect

In this case, the cost has resulted in 801.7517 (\$/h), which is considered 8.3608 % lower than the initial case (load flow). Fig. 4 shows the convergence characteristic of cost using GSA. Table 1 summarizes the optimal control variables setting in this case.

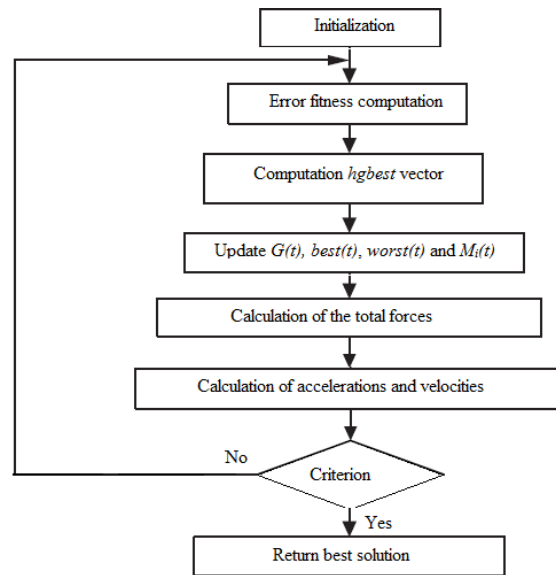


Fig. 2: Flowchart of GSA.

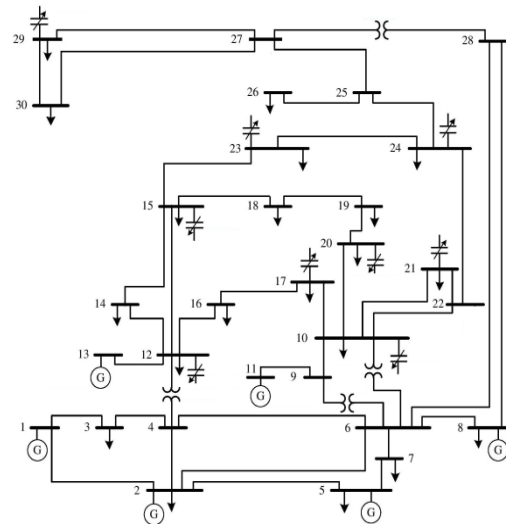


Fig. 3: Single-line diagram of IEEE 30-bus system.

3.1.2. Case 2: Cost optimization with valve point effect

In this case, the cost has resulted in 834.85 (\$/h), which is considered 3.837% lower than the initial case. Table 1 summarizes the optimal control variables of this case. Fig. 4 illustrates the convergence algorithms for case 2.

3.1.3. Case 3: Active power loss optimization

The optimal control variables of this case are introduced in Table 1. Fig. 5 shows the convergence characteristics of active power losses using GSA algorithm. The active power loss has dramatically decreased to 5.4074 (MW) which is considered 81.5905% lower than the basic case.

3.1.4. Case 4: Gas emission optimization

In this case, the emission reduction yielded 0.2162 (ton/h), which is considered 97.7962% lower than initial case.

Table 1: Results of cases 1, 2 and 3 for test system.

Control variables	Optimal values		
	Case 1 Cost w/o valve	Case 2 Cost w/ valve	Case 3 Losses
P _{G2} (MW)	49.3452	36.9639	42.1640
P _{G5} (MW)	21.1403	16.3928	49.9853
P _{G8} (MW)	21.2490	10.3052	34.9261
P _{G11} (MW)	11.9704	11.1055	29.8481
P _{G13} (MW)	12.0421	12.0007	37.5303
V ₁ (pu)	1.0860	1.0603	1.0696
V ₂ (pu)	1.0673	1.0330	1.0559
V ₅ (pu)	1.0380	1.0062	1.0326
V ₈ (pu)	1.0391	0.9967	1.0396
V ₁₁ (pu)	1.0926	1.0056	1.0781
V ₁₃ (pu)	1.0444	1.0668	1.0255
Q _{com10} (MVar)	1.3214	1.0262	3.2206
Q _{com12} (MVar)	1.2352	2.0189	0.6561
Q _{com15} (MVar)	1.9913	2.5747	4.0699
Q _{com17} (MVar)	3.1741	2.0459	2.8506
Q _{com20} (MVar)	0.9824	2.5540	2.3771
Q _{com21} (MVar)	3.8632	3.7772	3.8207
Q _{com23} (MVar)	3.8792	1.4481	4.3263
Q _{com24} (MVar)	2.4345	2.1937	2.3369
Q _{com29} (MVar)	2.6679	2.4615	1.5492
T ₆₋₉	1.0042	1.0037	1.0329
T ₆₋₁₀	1.0021	0.9824	0.9452
T ₄₋₁₂	0.9574	0.9404	0.9911
T ₂₈₋₂₇	0.9762	0.9630	0.9873
Cost in (\$/h)	800.751	834.85	912.19
loss in (MW)	9.0937	12.264	3.837
Emission (ton/h)	0.3117	0.3211	0.2161
Slack in (MW)	176.7467	208.899	92.7820
CPU time (s)	87.2648	86.756	77.595

The optimal settings of control variables of this case are detailed in Table 2. The convergence characteristic of emission using GSA method is shown in Fig. 6.

3.1.5. Case 5: Cost and active loss optimization

The multi-objective control variables considering cost and active loss are tabulated in Table 2. Fig. 7 shows the trend of optimization for this case using GSA method.

3.1.6. Case 6: Cost and gas emission optimization

Fig. 8 shows the convergence characteristics obtained in case 6. The results of this case are tabulated in Table 3.

3.1.7. Case 7: Cost, active power loss and gas emission

The control variables setting of multi-objectives considering cost, active power loss and emission are given in Table 3. The convergence characteristics of this case are shown in Fig. 9.

In order to obtain the desired set of non-dominant solution points, we run the algorithm with different weight factor. Therefore, the multi-objective problem is transformed into a single objective problem using the linear summation of weight factors according to (34).

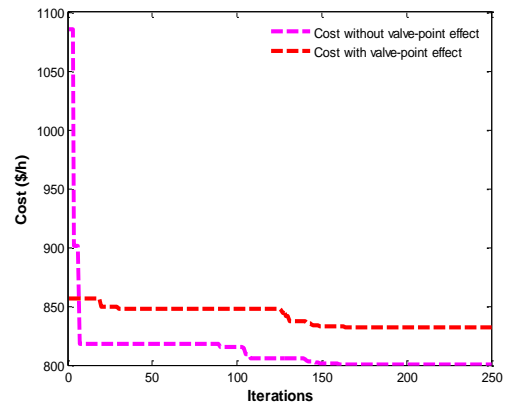


Fig. 4: Convergence of algorithm for cases 1 and 2.

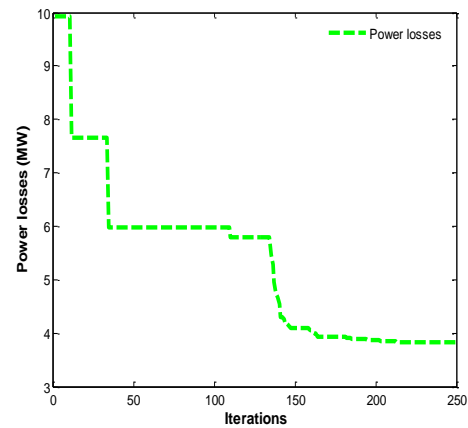


Fig. 5: Convergence of algorithm for case 3.

$$f_{multi-objective} = w_c \cdot f_1 + w_l \cdot f_3 + w_e \cdot f_4 \quad (34)$$

where w_c , w_l and w_e are, respectively, the weight factor for cost, losses and emission functions and $w_c + w_l + w_e = 1$. Table 4 shows the obtained results using different weight factors.

From the results presented in Table 1 and Figs. 4, 5, and 6 it can appear that, the GSA method is considered to have given best results for multi-objective OPF based combined economic dispatch and emission because they obtained better results compared to those known references.

The developed GSA has been implemented and used to solve the OPF combined economic dispatch with valve-point effect and emission for IEEE 30-bus system under varying operating conditions. The cost function is considered to be quadratic function.

From Figs. 7, 8, and 9, all cases study of multi-objective results obtained the minimum values after 120 iterations.

Table 5 shows a comparison between the obtained single and multi-objective results of costs, power losses and emission with the results obtained in literature.

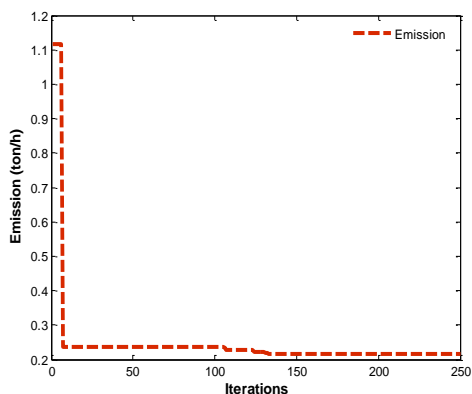


Fig. 6: Convergence of algorithm for case 4.

Table 2: Results of cases 4 and 5 for IEEE 30-bus system.

Control variables	Optimal values		
	Case 4	Case 5	
	<i>Emission</i>	<i>w/o valve</i>	<i>w/ valve</i>
P_{G2} (MW)	55.2162	51.7103	48.8408
P_{G5} (MW)	48.4827	30.7894	30.4953
P_{G8} (MW)	22.8868	34.9894	34.9624
P_{G11} (MW)	29.9986	23.4313	19.1652
P_{G13} (MW)	31.4252	21.1699	21.3077
V_1 (pu)	1.0863	1.0713	1.0673
V_2 (pu)	1.0728	1.0581	1.0501
V_5 (pu)	1.0228	1.0321	1.0202
V_8 (pu)	1.0097	1.0420	1.0309
V_{11} (pu)	1.0493	1.0644	1.0623
V_{13} (pu)	1.0248	1.0602	1.0551
Q_{com10} (MVar)	1.4597	3.7160	4.6011
Q_{com12} (MVar)	4.2850	2.9271	4.2547
Q_{com15} (MVar)	1.3286	3.9829	1.4724
Q_{com17} (MVar)	3.0464	1.2142	4.5426
Q_{com20} (MVar)	3.3183	2.6623	3.9967
Q_{com21} (MVar)	3.1756	3.1168	4.9962
Q_{com23} (MVar)	3.1649	1.3367	4.0620
Q_{com24} (MVar)	3.0629	4.3422	3.5058
Q_{com29} (MVar)	2.7770	3.3533	1.4227
T_{6-9}	0.9902	0.9953	0.9658
T_{6-10}	1.0132	0.9589	1.0312
T_{4-12}	0.9408	1.0010	0.9731
T_{27-28}	0.9755	0.9819	0.9557
Cost in (\$/h)	1025.9600	824.87	862.78
loss in (MW)	5.245	05.827	06.284
Emission (ton/h)	0.229	0.2524	0.2557
Slack in (MW)	100.636	127.1374	134.913
CPU time (s)	77.306	81.0773	80.756

The proposed method to solve the OPF combined economic dispatch with valve-point effect and emission is considered to have given the best results because the results obtained using the GSA method are better compared to those published recently in several researches papers.

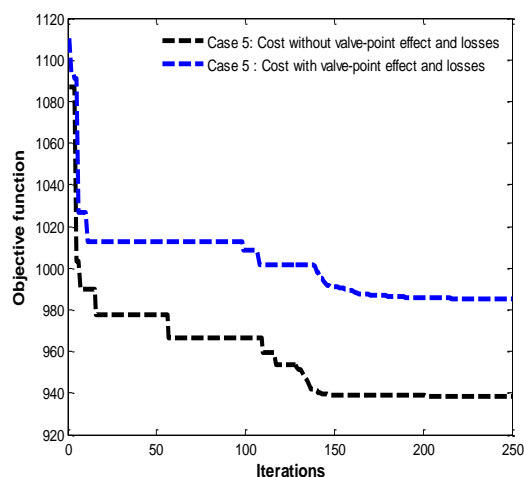


Fig. 7: Convergence of algorithm for case 5.

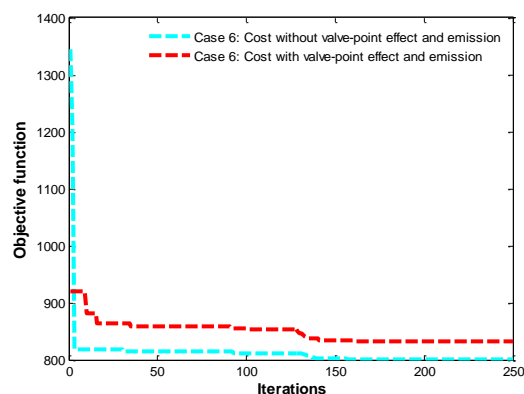


Fig. 8: Convergence characteristics for case 6.

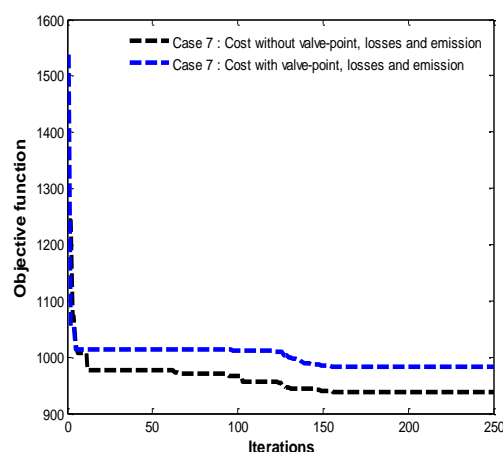


Fig. 9: Convergence characteristics for the case 7.

Through the results obtained in Table 5, we note that the optimal values of the different objective functions are affected by the change of weight factors. The larger the weight factor, the more optimal the value of the objective function.

Table 3: Results of cases 6 and 7 for IEEE 30-bus system.

Control variables	Optimal values			
	Case 6		Case 7	
	w/o valve	With valve	w/o valve	with valve
P _{G2} (MW)	48.9786	42.8649	52.2267	47.7413
P _{G5} (MW)	21.1630	16.6036	30.5107	29.2543
P _{G8} (MW)	21.3428	13.9896	35.0000	34.9274
P _{G11} (MW)	11.8295	10.0373	24.4152	25.4630
P _{G13} (MW)	12.0012	12.0919	20.6417	17.2960
V ₁ (pu)	1.0809	1.0859	1.0717	1.0722
V ₂ (pu)	1.0624	1.0660	1.0577	1.0568
V ₅ (pu)	1.0325	1.0365	1.0327	1.0291
V ₈ (pu)	1.0375	1.0217	1.0424	1.0366
V ₁₁ (pu)	1.0459	1.0812	1.0821	1.0777
V ₁₃ (pu)	1.0180	1.0277	1.0597	1.0507
Q _{com10} (MVar)	3.9395	2.2226	4.1934	3.0310
Q _{com12} (MVar)	2.7670	1.6456	1.9471	3.1556
Q _{com15} (MVar)	3.1526	1.4549	2.1550	2.0520
Q _{com17} (MVar)	2.4079	3.7126	2.0085	3.9209
Q _{com20} (MVar)	3.5253	2.0909	3.0977	1.8054
Q _{com21} (MVar)	4.3362	0.7274	4.8694	4.6344
Q _{com23} (MVar)	3.7058	1.3824	2.3529	3.5211
Q _{com24} (MVar)	4.9791	4.1553	4.6928	3.2256
Q _{com29} (MVar)	1.0175	1.8858	3.1813	1.9244
T ₆₋₉	1.0588	0.9958	1.0198	0.9929
T ₆₋₁₀	0.9963	1.0163	0.9503	1.0325
T ₄₋₁₂	1.0190	0.9525	0.9884	1.0253
T ₂₇₋₂₈	1.0084	0.9633	0.9882	0.9817
Cost in (\$/h)	800.89	834.69	825.170	862.90
loss in (MW)	09.157	10.951	5.775	6.1693
Emission (ton/h)	0.3203	0.3203	0.3203	0.3203
Slack in (MW)	177.246	198.764	126.381	134.887
CPU time (s)	74.072	84.152	83.059	79.020

Table 4: Results of case 7 with different weight factors.

	W _c	W _l	W _e
	0.9	0.08	0.02
Cost (\$/h)	862.90	864.71	865.10
Losses (MW)	6.1693	6.2012	6.1921
Emission (ton/h)	0.3203	0.3101	0.3100
	0.8	0.15	0.15
Cost (\$/h)	863.10	864.71	865.10
Losses (MW)	6.9731	6.9958	6.9547
Emission (ton/h)	0.3199	0.3158	0.30258
	0.5	0.25	0.25
Cost (\$/h)	863.80	864.71	865.10
Losses (MW)	6.3257	6.2012	6.1921
Emission (ton/h)	0.3302	0.3354	0.3434
	0.338	0.335	0.327
Cost (\$/h)	866.65	862.90	862.90
Losses (MW)	6.7000	7.2121	7.123
Emission (ton/h)	0.24156	0.2315	0.3058

Table 5: Comparison of obtained and literature results.

Methods		Cost (\$/h)	Losses (MW)	Emission (\$/ton)
Methods	Ref.			
Case 5				
Proposed	-	824.87	5.827	0.2524
MSA	[36]	859.191	4.540	-
IABC	[19]	854.913	4.982	-
PSO	[31]	878.873	7.810	-
MDE	[25]	820.880	5.594	-
Case 6				
Proposed	-	800.89	9.157	0.267
GA	[30]	820.166	-	0.271
MICA	[39]	865.066	-	0.222
Case 7				
Proposed	-	825.17	5.775	0.227
GA	[30]	793.605	8.450	0.187
IABC	[19]	851.611	4.873	0.223
ABC	[18]	854.916	4.982	0.228

4. CONCLUSION

The GSA method was successfully implemented in this paper to find the optimum OPF control variables for single objective and multi-objective optimization. The versatility of the multi-objective OPF optimization is illustrated by different tests systems by changing the parameters of GSA method such as population size N_a and control parameters, α and G_0 . The analysis performance of used methodology is illustrated by the numerical and graphical results as shown in all tables and figures. The proposed method has fast convergence time in all cases test due of obtained performance. Through the obtained results, the power generation cost, active losses and emission index were significantly reduced to 5.85%, 61.61% and 44.63% %, respectively, from the base case and these results obtained are considered good results compared to some references. The effectiveness and robustness of used method are demonstrated by the obtained results. Therefore, it can be recommended to future researchers as a promising algorithm for solving some more complex engineering optimization problems. However, we have to mention that it becomes slow if the numbers of system variables are increased. It is found that the average CPU time increases rapidly as system size increases and convergence slows down.

CREDIT AUTHORSHIP CONTRIBUTION STATEMENT

Nabil Mezhoud: Conceptualization, Data curation, Formal analysis, Investigation, Methodology, Resources Software, Supervision, Validation, Visualization, Writing - original draft, Writing - review & editing. **Mohamed Amarouayache:** Conceptualization, Formal analysis, Investigation, Project administration, Resources Software, Supervision, Visualization, Writing - original draft.

DECLARATION OF COMPETING INTEREST

The authors declare that they have no known competing financial interests or personal relationships that could have appeared to influence the work reported in this paper. The ethical issues; including plagiarism, informed consent, misconduct, data fabrication and/or falsification, double

publication and/or submission, redundancy has been completely observed by the authors.

REFERENCES

- [1] J. H. Talaq, F. El-Hawary, and M. E. El-Hawary, "A summary of environmental/economic dispatch algorithms," *IEEE Transactions on Power Systems*, vol. 9, no. 3, pp. 1508-1516, 1994.
- [2] C. Kumar, and Ch. P. Raju, "Constrained OPF using Particle Swarm Optimization," *Int. J. of Em. Tech. and Adv. Eng.*, vol. 2, no 2, pp. 235-241, 2012.
- [3] A. A. A. Mohamed, A. A. M. El-Gaafary, Y. S. Mohamed, and A. M. Hemeida, "Multi-Objective Modified Grey Wolf Optimizer for OPF," in *IEEE Eighteenth International Middle East Power Systems Conference (MEPCON)*, 2016.
- [4] H. W. Dommel, and W. F. Tinney, "OPF Solutions", *IEEE Transactions on Power Apparatus and Systems*, vol. 87, no. 10, pp. 1866-1876, 1968.
- [5] S. A. H. Soliman, and A. A. H. Mantawi, *Modern Optimization Techniques with Applications in Electric Power System*. Springer, New York, USA, 2012, pp. 281-346.
- [6] L. L. Lai, and J. T. Maimply, "Improved genetic algorithms for optimal power flow under both normal contingent operation states," *International Journal of Electrical Power & Energy Systems*, vol. 19, no. 5, pp. 287-292, 1997.
- [7] H. Nicholson, and M. J. H. Sterling, "Optimum dispatch of active and reactive generation by quadratic programming," *IEEE Transactions on Power Apparatus and Systems*, vol. 72, pp. 644-654, 1973.
- [8] Costa, G. R. M. da., Costa, and C. E. U., "Improved newton method for optimal power flow problem," *International Journal of Electrical Power and Energy Systems*, vol. 22, no. 7, pp. 459-462, 2000.
- [9] T. C. Giras, and S. N. Talukdar, "Quasi-newton method for optimal power flows," *International Journal of Electrical Power and Energy Systems*, vol. 3, no. 2, pp. 59-64, 1981.
- [10] B. Stott, and E. Hobson, "Power system Security control calculations using linear programming, Part-2," *IEEE Transactions on Power Apparatus and Systems*, vol. 97, no. 5, pp. 1721-1731, 1978.
- [11] A. M. Sasson, "Nonlinear programming solutions for load-flow, minimum-loss, and economic dispatching problems," *IEEE Transactions on Power Apparatus and Systems*, vol. 88, no. 4, pp. 399-409, 1969.
- [12] F. Capitanescu, M. Glavic, D. Ernst, and L. Wehenkel, "Interior-point based algorithms for the solution of optimal power flow problems," *Electric Power Systems Research*, vol. 77, pp. 508-517, 2007.
- [13] L. L. Lai, *Intelligent System Applications in Power Engineering: Evolutionary Programming and Neural Networks*. Wiley, New York, USA, 1998.
- [14] S. Mouassa, and T. Bouktir, "Artificial bee colony algorithm for solving OPF problem considering the valve point effect," *International Journal of Computer Applications*, vol. 112, no. 1, pp. 45-53, 2015.
- [15] D. Aydın, and S. Özyön, "Solution to non-convex economic dispatch problem with valve point effects by incremental artificial bee colony with local search," *Applied Soft Computing*, vol. 13, no. 5, pp. 2456-2466, 2013.
- [16] Z. Zakaria, T. K. A. Rahman, and E. E. Hassan, Economic Load Dispatch via an Improved Bacterial Foraging Optimization, in *IEEE 8th International Power Engineering and Optimization Conference*, Langkawi, The Jewel of Kedah, Malaysia, 2014.
- [17] S. M. Abd-Elazim, and E. S. Ali, "Optimal power system stabilizers design via Cuckoo search algorithm," *International Journal of Electrical Power & Energy Systems*, vol. 75, no.1, pp. 99-107, 2016.
- [18] A. H. Khazali, and M. Kalantar, "Optimal reactive power dispatch based on harmony search algorithm," *International Journal of Electrical Power and Energy Systems*, vol. 33, no. 3, pp. 684-692, 2011.
- [19] J. Yuryevich, and K. P. Wong, "Evolutionary programming based optimal power flow algorithm," *IEEE Transactions on Power Systems*, vol. 14, no. 4, pp. 1245 - 1250, 1999.
- [20] A. A. Abou El Ela, M. A. Abido, and S. R. Spea, "Optimal power flow using differential evolution algorithm," *Electric Power Systems Research*, vol. 91, no. 7, pp. 878-885, 2010.
- [21] S. Sayah, and K. Zehar, "Modified differential evolution algorithm for optimal power flow with non-smooth cost functions," *Energy Conversion and Management*, vol. 4, pp. 3036-3042, 2008.
- [22] M. A. Abido, "Optimal power flow using Tabu search algorithm," *Electric Power Components and Systems*, vol. 30, N°. 5, pp. 469-483, 2010.
- [23] Y.J. Jeon, and J. C. Kim, "Application of simulated annealing and Tabu search for loss minimization in distribution systems," *International Journal of Electrical Power and Energy Systems*, vol. 26, no. 1, pp. 9-18, 2004.
- [24] A. R. Bhowmik, and A. K. Chakraborty, "Solution of optimal power flow using non-dominated sorting multi-objective gravitational search algorithm," *International Journal of Electrical Power and Energy Systems*, vol. 62, no. 4, pp. 323-334, 2014.
- [25] S. S. Reddy, P. R. Bijwe, and A. R. Abhyankar, "Faster evolutionary algorithm based optimal power flow using incremental variables," *International Journal of Electrical Power & Energy Systems*, vol. 54, no. 1, pp. 198-210, 2014.
- [26] C. Yasar, and S. Özyön, "A new hybrid approach for nonconvex economic dispatch problem with valve-point effect," *Energy*, vol. 36, no. 10, pp. 5838-5845, 2011.

- [27] M. A. Abido, "OPF using particle swarm optimization," *Electrical Power and Energy System*, vol. 24, no. 1, pp. 563-571, 2002.
- [28] J. Y. Kim, H. S. Lee, and J. H. Park, "A modified particle swarm optimization for OPF," *Journal of Electrical Engineering and Technology*, vol. 2, no. 4, pp. 413-419, 2007.
- [29] A. Ketabi, and A. A. R. Feuillet, "Application of the ant colony search algorithm to reactive power pricing in an open electricity market," *International Journal of Electrical Power & Energy Systems*, vol. 32, no. 6, pp. 622-628, 2010.
- [30] A. El-Fergany, and H. M. Hasanien, "Tree-seed algorithm for solving optimal power flow problem in large-scale power," *Syst. Inc. Val. and Comp.*, vol. 64, no. 1, pp. 307-316, 2018.
- [31] A. A. A. Mohamed, Y. S. Mohamed, A. A. M. El-Gaafary, and A. M. Hemeida, "Optimal power flow using moth swarm algorithm," *Electric Power Systems Research*, vol. 142, pp. 190-206, 2017.
- [32] A. F. Attia, R. A. El-Sehiemy, and H. M. Hasanien, "OPF solution in power systems using a novel sine-cosine algorithm," *Electrical Power and Energy Systems*, vol. 99, no. 3, pp. 331-343, 2018.
- [33] S. S. Padaiyatchi, "Hybrid DE/FFA algorithm applied for different optimal reactive power dispatch problems," *Australian Journal of Electrical and Electronics Engineering*, vol. 17, no. 3, pp. 203-210, 2020.
- [34] M. Ghasemi, S. Ghavidel, M. M. Ghanbarian, M. Gharibzadeh, and A. A. Vahed, "Multi-objective optimal power flow considering the cost, emission, voltage deviation and power losses using multi-objective modified imperialist competitive algorithm," *Energy*, vol. 2014, pp. 1-14, 2014.
- [35] A. K. Khamees, A. El-Rafei, N. M. Badra, and A. Y. Abdelaziz, "Shuffled frog leaping algorithm," *International Journal of Engineering, Science and Technology*, vol. 9, no. 1, pp. 55-68, 2017.
- [36] H. R. El-Hana Bouchekara, M. A. Abido, and A. E. Chaib, "Optimal power flow using an improved electromagnetism-like mechanism method," *Electric Power Components and Systems*, vol. 44, no. 4, pp. 434-449, 2016.
- [37] I. N. Trivedi, P Jangir, and S. A. Parmar, "Optimal power flow with enhancement of voltage stability and reduction of power loss using ant-lion optimizer," *Cogent Engineering*, 2016.
- [38] B. Bentouati, S. Chettih, and L. Chaib, "Interior search algorithm for optimal power flow with non-smooth cost functions", *Cogent Engineering*, vol. 2017, pp. 1-17, 2017.
- [39] R. Senthilkumar, P. Sk. Karimulla, K. B. V. S. R. Subrahmanyam, and R. Deshmukh, "Solution for optimal power flow problem using WDO algorithm," *Turkish Journal of Computer and Mathematics Education*, vol. 12, no. 2, pp. 889-895, 2021.
- [40] F. Hasan, A. Kargarian, and A. Mohammadi. "A survey on applications of machine learning for optimal power flow," in *IEEE Texas Power and Energy Conference (TPEC)*, 2020.
- [41] S. Gupta, N. Kumar, L. Srivastava, H. Malik, A. Anvari-Moghaddam, and F. P. A. García Márquez, "Robust optimization approach for optimal power flow solutions using Rao algorithms," *Energies*, vol. 14, pp. 1-28, 2021.
- [42] K. Bhattacharjee, K. Shah, and J. Soni, "Solving economic dispatch using artificial EcoSystem-based optimization," *Electric Power Components and Systems*, vol. 50, no. 1, 2022.
- [43] H. T. Ul-Hassan, M. F. Tahir, K. Mehmood, K. M. Cheema, A. H. Milyani, and Q. Rasool, "Optimization of power flow by using Hamiltonian technique," *Energy Reports*, vol. 6, no. 11, pp. 2267-2275, 2020.
- [44] E. Akbari, M. Ghasemi, M. Gil, A. Rahimnejad, and S. A. Gadsden, "Optimal power flow via teaching-learning-studying-based optimization algorithm," *Electric Power Components and Systems*, vol. 49, no. 6-7, pp. 584-601, 2021.
- [45] L. Dilip, R. Bhesdadiya, R. I. Trivedi, and P. Jangir, "OPF Problem Solution using Multi-objective Grey Wolf Optimizer Algorithm" in *Intelligent Communication and Computational Technologies, Networks and Systems*, 2018, pp. 191-201.
- [46] N. Mezhoud, B. Ayachi and B. Ahmed. Wind Driven Optimization Approach based Multi-objective OPF and Emission Index Optimization. *International Research Journal of Multidisciplinary Technovation*, vol. 4, no. 2, pp. 21-41, 2022.
- [47] S. Jiang, Z. Ji, and Y. Shen, "A novel hybrid particle swarm optimization and gravitational search algorithm for solving economic emission load dispatch problems with various practical constraints," *Electrical Power and Energy Systems*, vol. 55, no. 11, pp. 628-644, 2014.
- [48] Rashedi E, Rashedi E, Nezamabadi-pour, and H. Saryazdi, "GSA: a gravitational search algorithm," *Information Sciences*, vol. 179, no. 13, pp. 2232-2248, 2009.
- [49] S. Duman, U. Güvenç, Y. Sönmez, and N. Yörükeren, "Optimal power flow using gravitational search algorithm," *Energy Conversion and Management*, vol. 59, pp. 86-95, 2012.
- [50] S. Jiang, C. Zhang, and S. Chen, "Sequential hybrid particle swarm optimization and gravitational search algorithm with dependent random coefficients," *Hindawi Mathematical Problems in Engineering*, vol. 2020.
- [51] S. Mirjalili, S. Zaiton, and M. Hashim, "A new hybrid PSO-GSA algorithm for function optimization," *International in 2010 Conference on Computer and Information Application*, pp. 374-377, 2010.

[52] K. Y. Lee, and M. El-Sharkawi, *Modern heuristic optimization techniques: Theory and applications in power systems*, New York, USA, 2008.

BIOGRAPHY



Nabil Mezhoud is a Lecturer Professor at the University of Skikda, Algeria. He received the Ph.D. degree in Electrical Engineering in 2017. He published several research papers in conferences, journals and reviews. His areas of interest are: modeling, simulation and application of FACTS and HVDC systems, application of intelligent techniques to optimal power flow (OPF) problem, hybrid and multi-objective OPF, power system stability and control, integrating of renewable energy into electrical

networks and smart grid systems. Email: mezhouab@yahoo.fr.



Mohamed Amarouyache is a Lecturer Professor at the University of Skikda, Algeria. He received the Ph.D. degree in Electrical Engineering in 2014. He published several research papers in conferences, journals and reviews. Currently, he is member of LES laboratory. His areas of interest are: renewable energy modelling and simulation, power system control and intelligent techniques, integrating renewable energy into electrical networks and smart grid systems. Email: amarouyachemohamed@yahoo.fr.

Copyrights

© 2023 Licensee Shahid Chamran University of Ahvaz, Ahvaz, Iran. This article is an open-access article distributed under the terms and conditions of the Creative Commons Attribution –Non-commercial 4.0 International (CC BY-NC 4.0) License (<http://creativecommons.org/licenses/by-nc/4.0/>).

